

BUILDING ISSUES
February 7, 2019 to February 25, 2019

BAILEY

Feb. 7, 2019 Overrun with mice – treatment schedule needs to be reexamined. Food being delivered to cafeteria is frequently deemed not fresh to serve.

BARTLETT

Feb. 14, 2019 Report of mouse droppings.

BUTLER

February 25, 2019

This has been going on for a while. It is extremely hot in certain rooms. I attached pictures of the new thermostats in our rooms.

Room 128 - 93

Room 134 -91


Room 135 -91


Room 127 - 91


These are accurate temperatures.


The only way to stop the heat is to take a pair of scissors and stick them into the heating unit and put it into the off position. Otherwise, the heaters blow hot air all day. It never stops blowing hot air.

I have been told it is a mechanical issue.

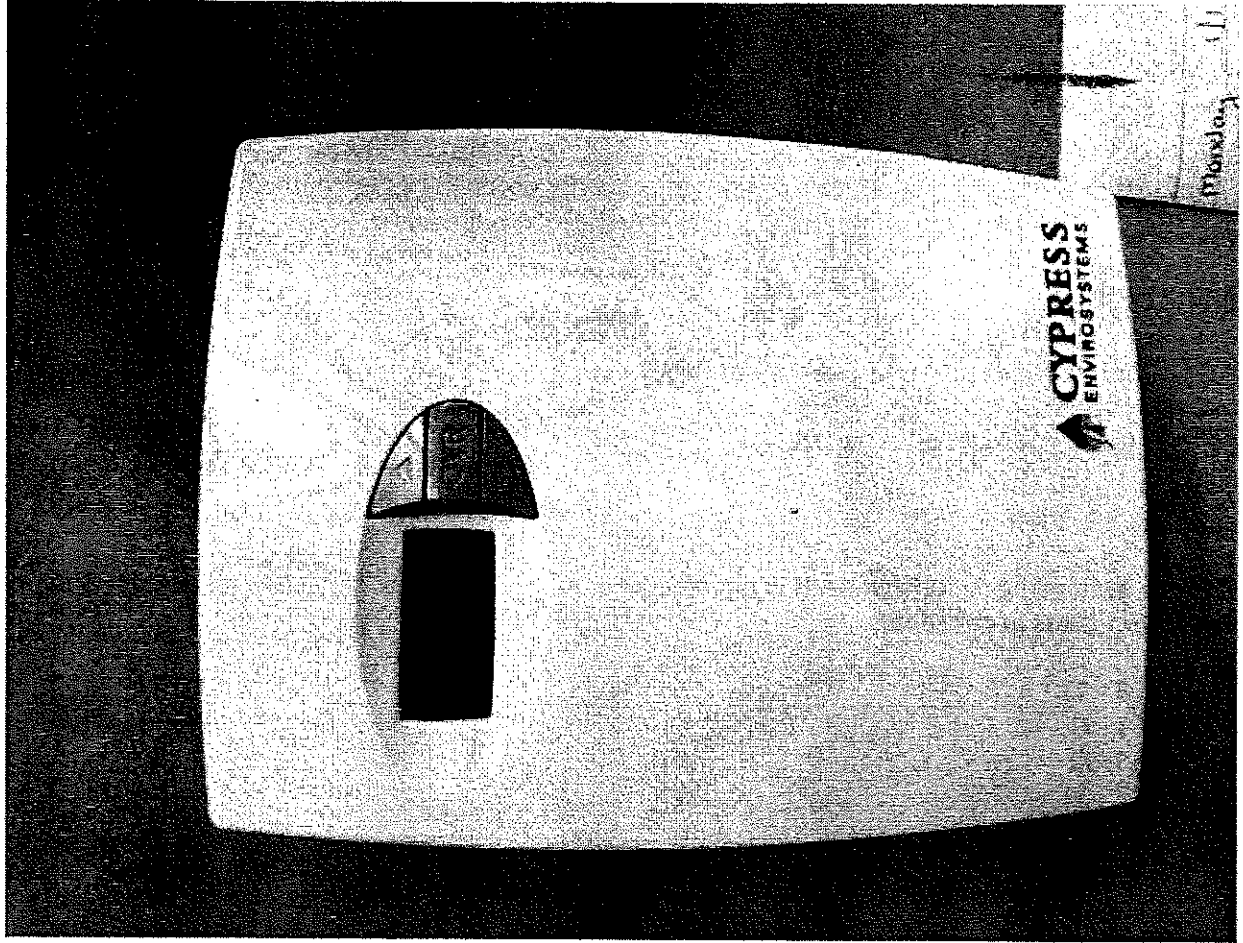

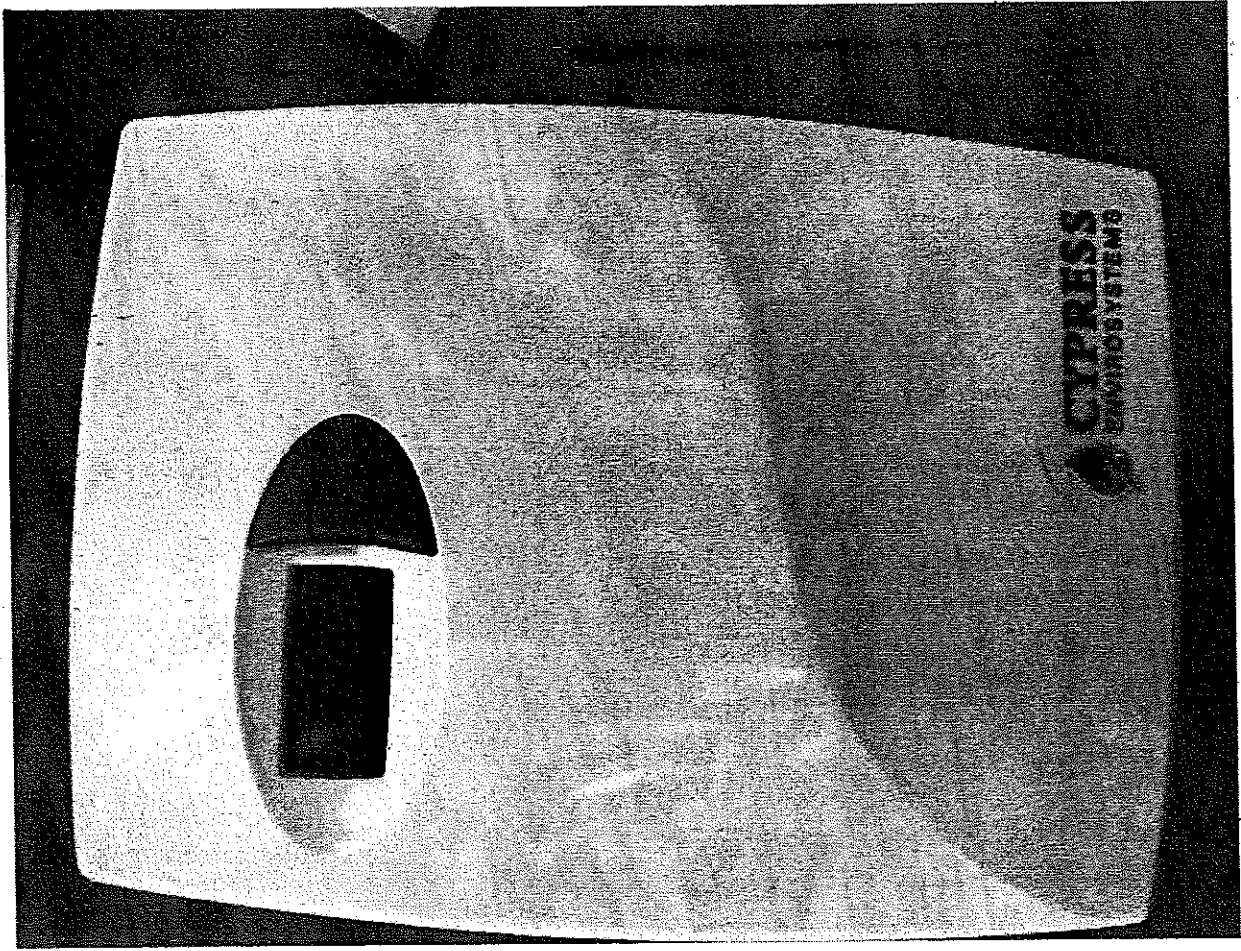

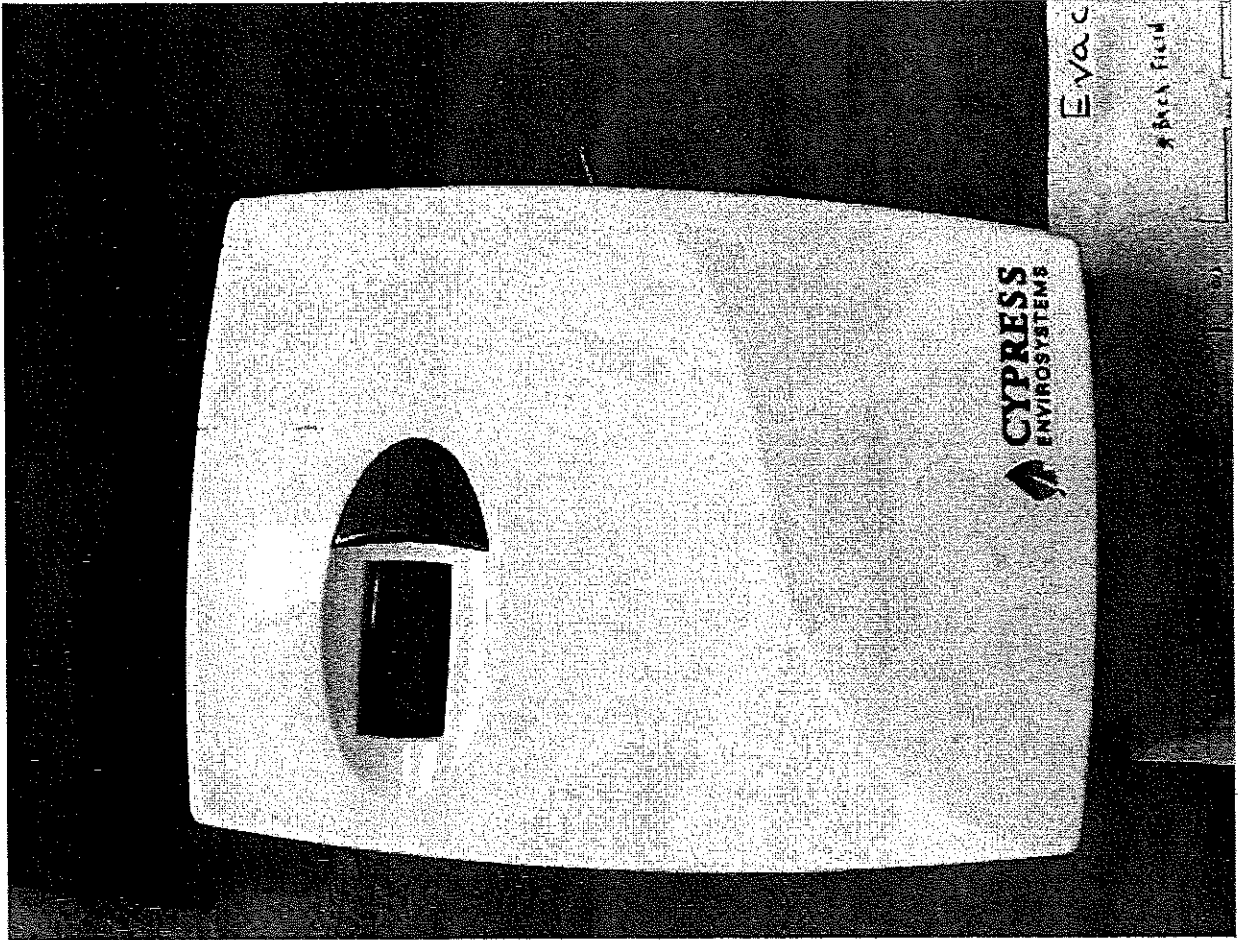

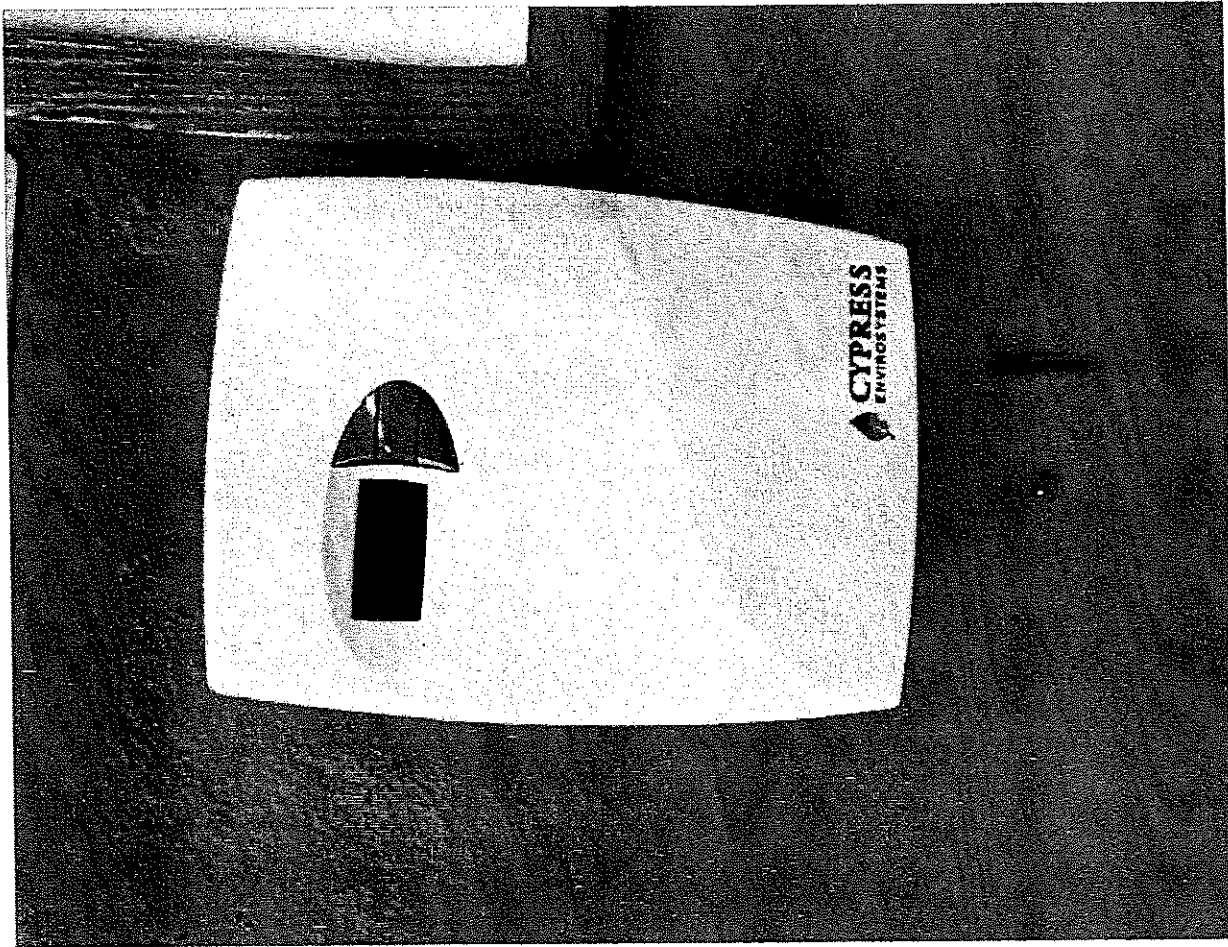

Sent from my iPhone

GREENHALGE

Feb. 7, 2019 PreK room leaking again – to be cleaned up later today

LEBLANC

Feb. 7, 2019 Installation of fire doors required.

LOWELL HIGH

Feb. 15, 2019 - Mouse activity reports from room 905 in the FA and room 128 in the 22 building.

Add 912 in the FA to the list.

Mouse activity classroom and lab area (643) at LHS.

ROGERS

Feb. 7, 2019

MANY, MANY classrooms in which the temperature is between 85-90 degrees and there's no way the heat can be regulated. Windows are being opened. Additionally, the school is INUNDATED with mice and it's a HUGE concern. There's a need to create a more frequent treatment schedule because what's happening now is not helping. There is concern that the building is NOT being treated twice a month as was noted at a couple of meetings.