


TREE PLANTING PLAN VIEW (TYP.)

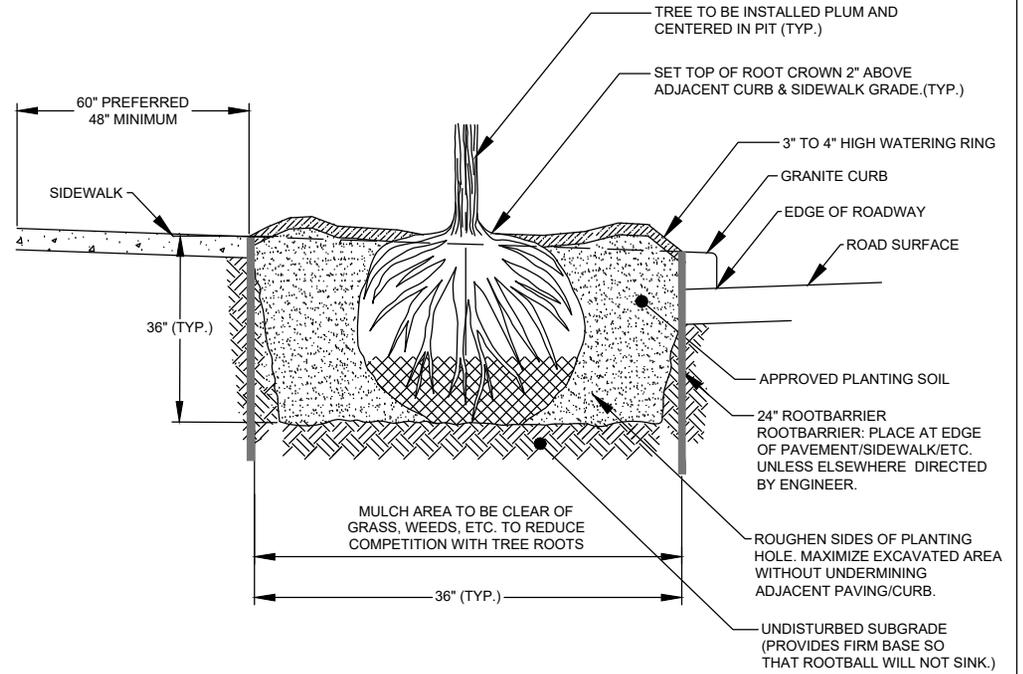

SECTION A-A (TYP.)

NOTE:

1. TREE PIT TO BE A MINIMUM OF 24 SQUARE FEET.
2. PROVIDE 10' LONG X 3" SQ.
3. CONTRACTOR SHALL PERFORM PERCOLATION TEST ON SUB-GRADE PRIOR TO PLANTING. IF TEST IS NOT PASSING, CONTRACTOR SHALL ADJUST SUB-GRADE ACCORDINGLY.

TREE PIT SPACING REQUIREMENTS

1. MINIMUM 5 FT FROM FIRE HYDRANTS
2. MINIMUM 3 FT FROM UNDERGROUND UTILITIES (WATER, SEWER, GAS)
3. MINIMUM 7 FT FROM DRIVEWAYS
4. MINIMUM 6 FT FROM TRAFFIC SIGNS
5. MINIMUM 30 FT FROM STOP SIGNS
6. MINIMUM 20 FT FROM LIGHT POLES
7. MINIMUM 30 FT BETWEEN TREE PITS (TREE-TO-TREE SPACING)



SIDEWALK - TREE PIT (3'X10')

City of Lowell Standard Specifications and Details

Spec. Ref #:

Date: 10/01/2025

Scale: N.T.S.