



NOTES:

1. PROVIDE EXPANSION JOINTS AT MIN 30' O.C. WITH PRE-MOULDED JOINT FILLER
2. PROVIDE TOOLED DUMMY JOINTS
3. PROVIDE BROOM FINISH IN DIRECTION PERPENDICULAR TO CURB
4. SCORE LINES PLACED AT INTERVALS EQUAL TO THE WIDTH OF THE SIDEWALK BUT NOT TO EXCEED FIVE (5) FEET.
5. SIDEWALKS TO BE BUILT IN COMPLIANCE WITH ADA REGULATIONS
6. SEE CEMENT CONCRETE SIDEWALK JOINTS DETAIL FOR MORE INFO

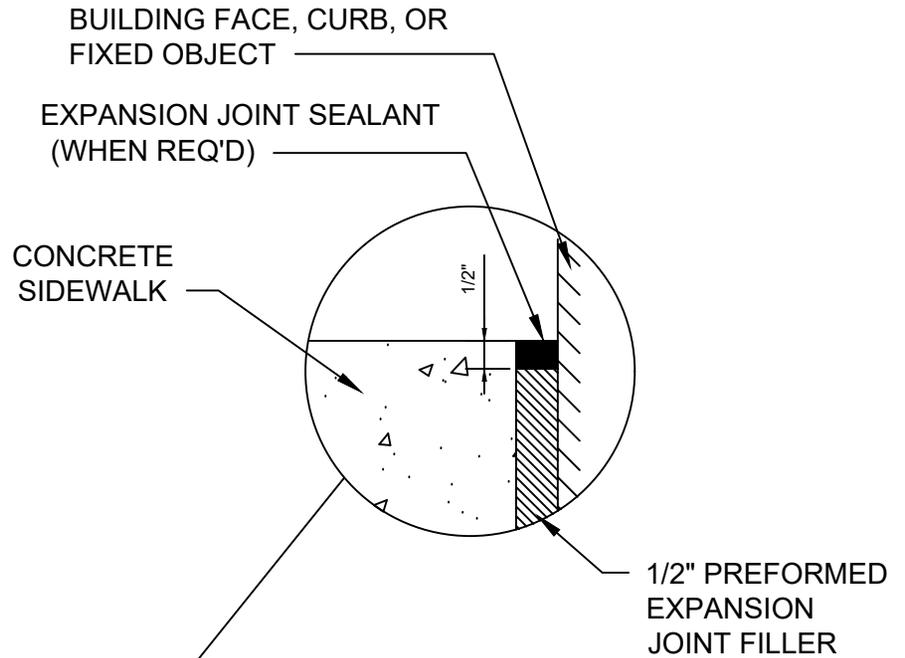

TOOLED CONTROL JOINTS

TOOLED EXPANSION JOINT

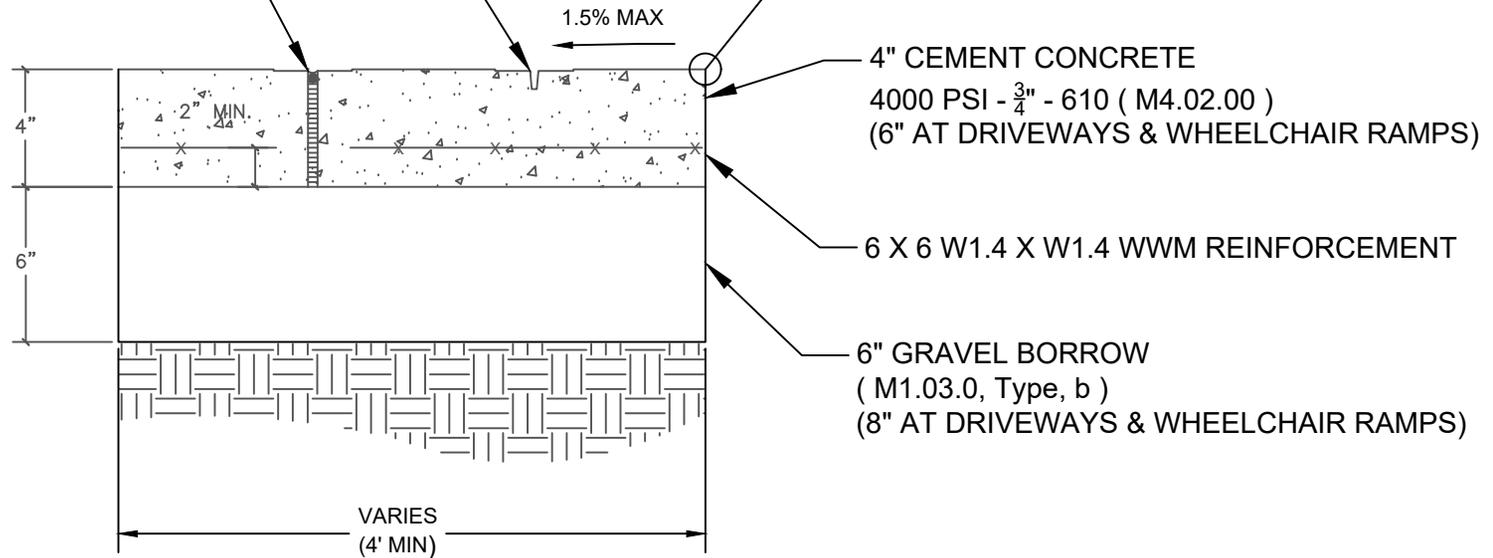

CONCRETE SIDEWALK SECTION

City of Lowell Standard Specifications and Details

Spec. Ref #:

Date: 10/01/2025

Scale: N.T.S.